



PLAN VIEW

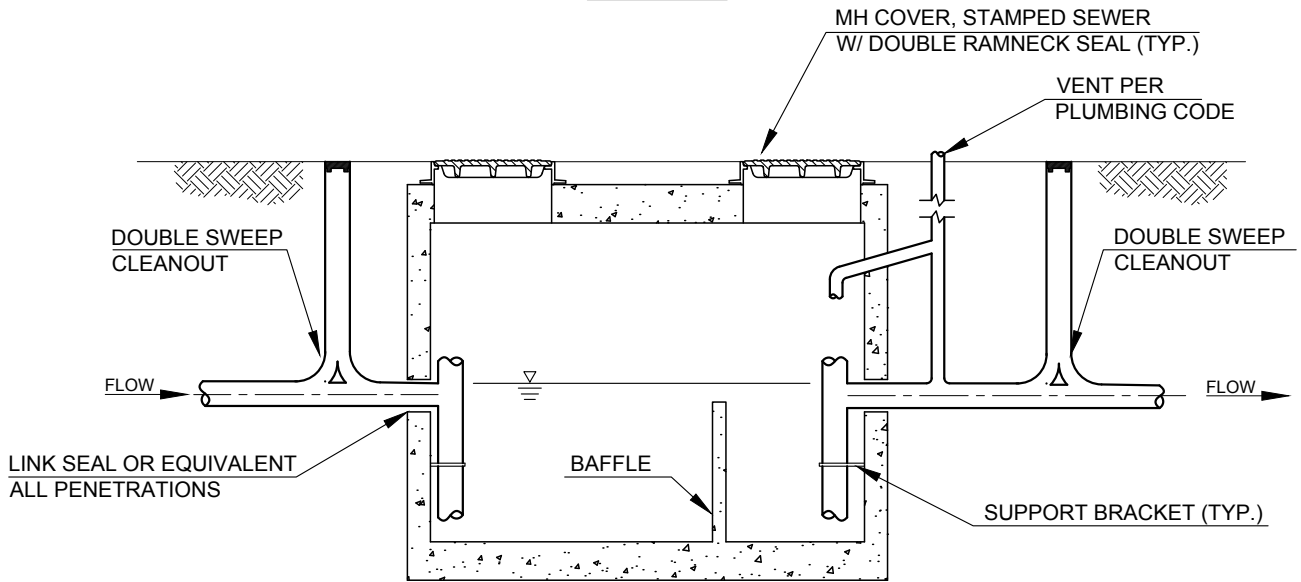

PROFILE VIEW

**NOTES:**

1. TO BE DESIGNED PER LOCAL BUILDING AND PLUMBING CODE.
2. INTERCEPTOR VAULT SHALL BE EXTERNAL TO THE BUILDING AND THE LID SHALL BE TRAFFIC RATED.
3. CAPACITY AND RETENTION TIME DESIGN SHALL BE BASED ON FIXTURE COUNT FLOW RATE PER PLUMBING CODE AND INCLUDE A MINIMUM CAPACITY 300 GALLONS.
4. DESIGNER TO SUBMIT SITE SPECIFIC DETAILED DESIGN DRAWINGS STAMPED BY A PROFESSIONAL ENGINEER FOR DISTRICT REVIEW AND APPROVAL.
5. SHALL BE LOCATED AS TO BE READILY AND EASILY ACCESSIBLE FOR CLEANING AND INSPECTION.
6. DRAINS FROM TOILETS RESTROOMS, SINKS AND SHOWERS SHALL NOT BE CONNECTED TO THE INTERCEPTOR.
7. TWO-COMPARTMENT OIL/SAND INTERCEPTORS, SHALL BE REQUIRED FOR EACH BAY IN ANY EXISTING OR PROPOSED VEHICLE OR EQUIPMENT WASHING OR CLEANING OPERATION.
8. INTERCEPTORS SHALL BE DESIGNED SO THAT STORMWATER OR GROUNDWATER CAN NOT ENTER.

REV. DATE:	1/2018	<b>SAND/OIL INTERCEPTOR</b>
SCALE:	N.T.S.	
 NORTH TABLE MOUNTAIN WATER AND SANITATION DISTRICT 14806 WEST 52ND AVENUE GOLDEN, COLORADO 80403-1228		DWG. NO. <b>S6</b>