


FOR SOFT OR UNSTABLE  
SUBGRADE SEE DETAIL  
BELOW.


**TYPICAL TRENCH**

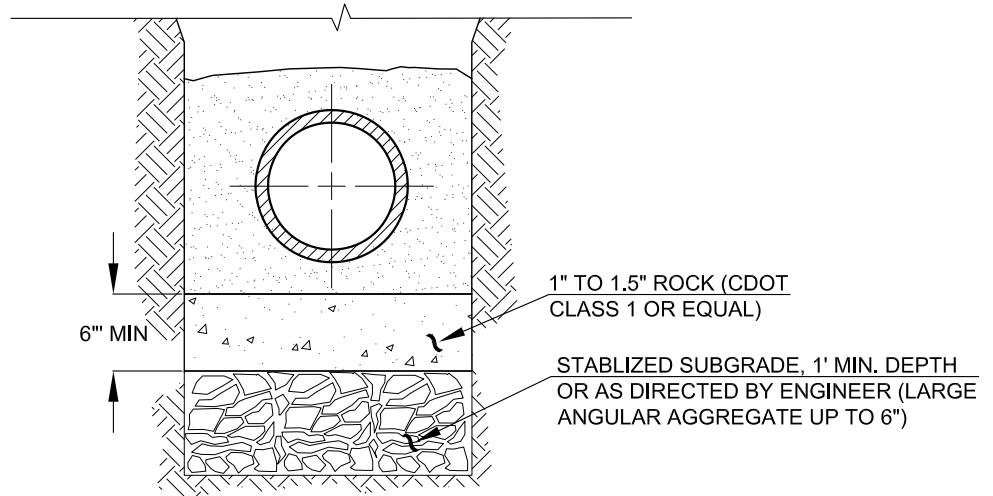

**UNSTABLE SUBGRADE**

**NOTES:**

1. NEW STREET SURFACE SHALL COMPLY WITH LOCAL JURISDICTION.
2. TRENCH WALLS TO BE SUPPORTED AS REQUIRED BY OSHA.
3. WHEN IT IS NECESSARY TO LOWER OR RAISE WATER LINES AT STORM DRAINS AND OTHER UTILITY CROSSINGS, A MINIMUM CLEARANCE OF 1.50 FEET SHALL BE MAINTAINED BETWEEN THE OUTSIDES OF THE PIPES

REV. DATE:	10/2012	<b>TRENCH SECTION</b>
SCALE:	N.T.S.	
 NORTH TABLE MOUNTAIN WATER AND SANITATION DISTRICT		DWG. NO.
14806 WEST 52ND AVENUE GOLDEN, COLORADO 80403-1228		<b>W1</b>